

SLAB METER SET



* NOTE:
For reference in placing new corporation stops, curb stops and curb boxes see L-9901.

** NOTE:
Pipe Shall Be Copper Tubing Size (C.T.S.)

NOTE:
Services through crawl spaces shall be sleeved, buried with a min. of 6" cover and insulated with a Division of Water Approved insulating material.

** Water Tap
3/4", 1", 1 1/2" or 2" Type K
Copper per Division of Water
Rule & Reg. No. 04-01.

Water Main
Corporation Stop *
Maintained By City

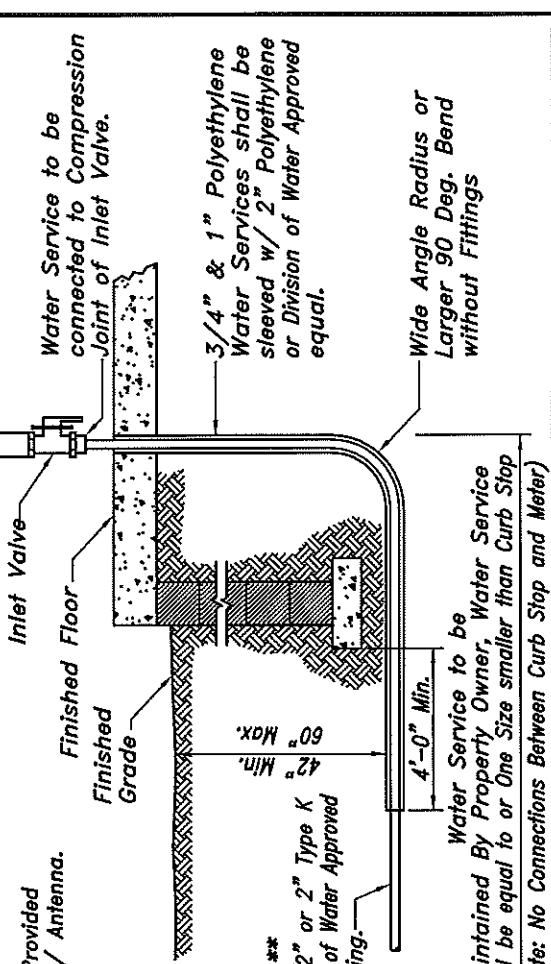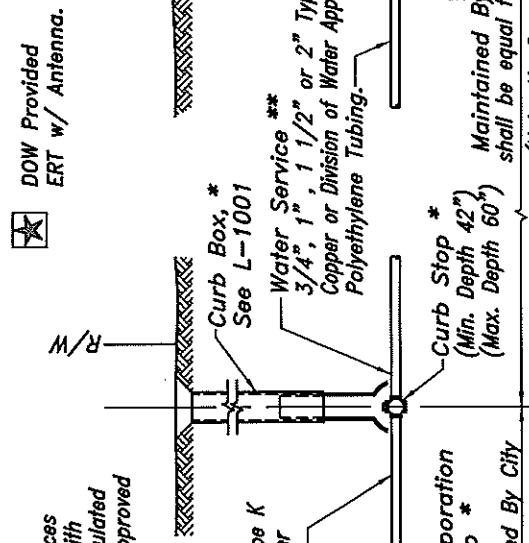



BASEMENT METER SET

* NOTE:
For reference in placing new corporation stops, curb stops and curb boxes see L-9901.

** NOTE:
Pipe Shall Be Copper Tubing Size (C.T.S.)

** Water Tap
3/4", 1", 1 1/2" or 2" Type K
Copper per Division of Water
Rule & Reg. No. 04-01.

Water Main
Corporation Stop *
Maintained By City

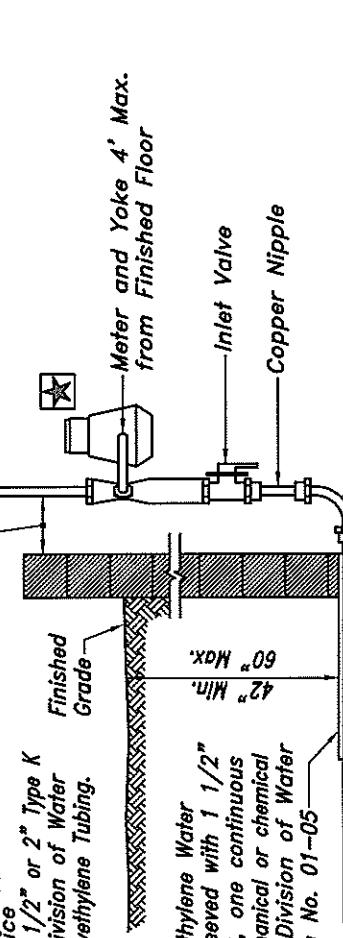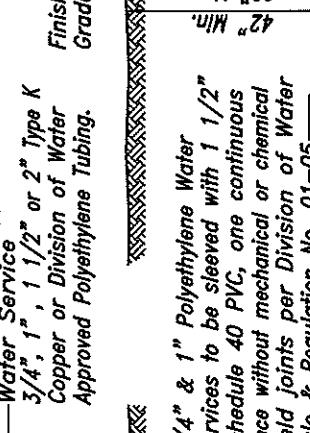

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER	APPROVED: <i>KC Westerfield</i> 5-16-13
ADMINISTRATOR	DATE

STANDARD DETAIL
METER INSTALLATION IN BUILDING
5/8" THRU 1" METERS

